


**PHASE 1 & 2**

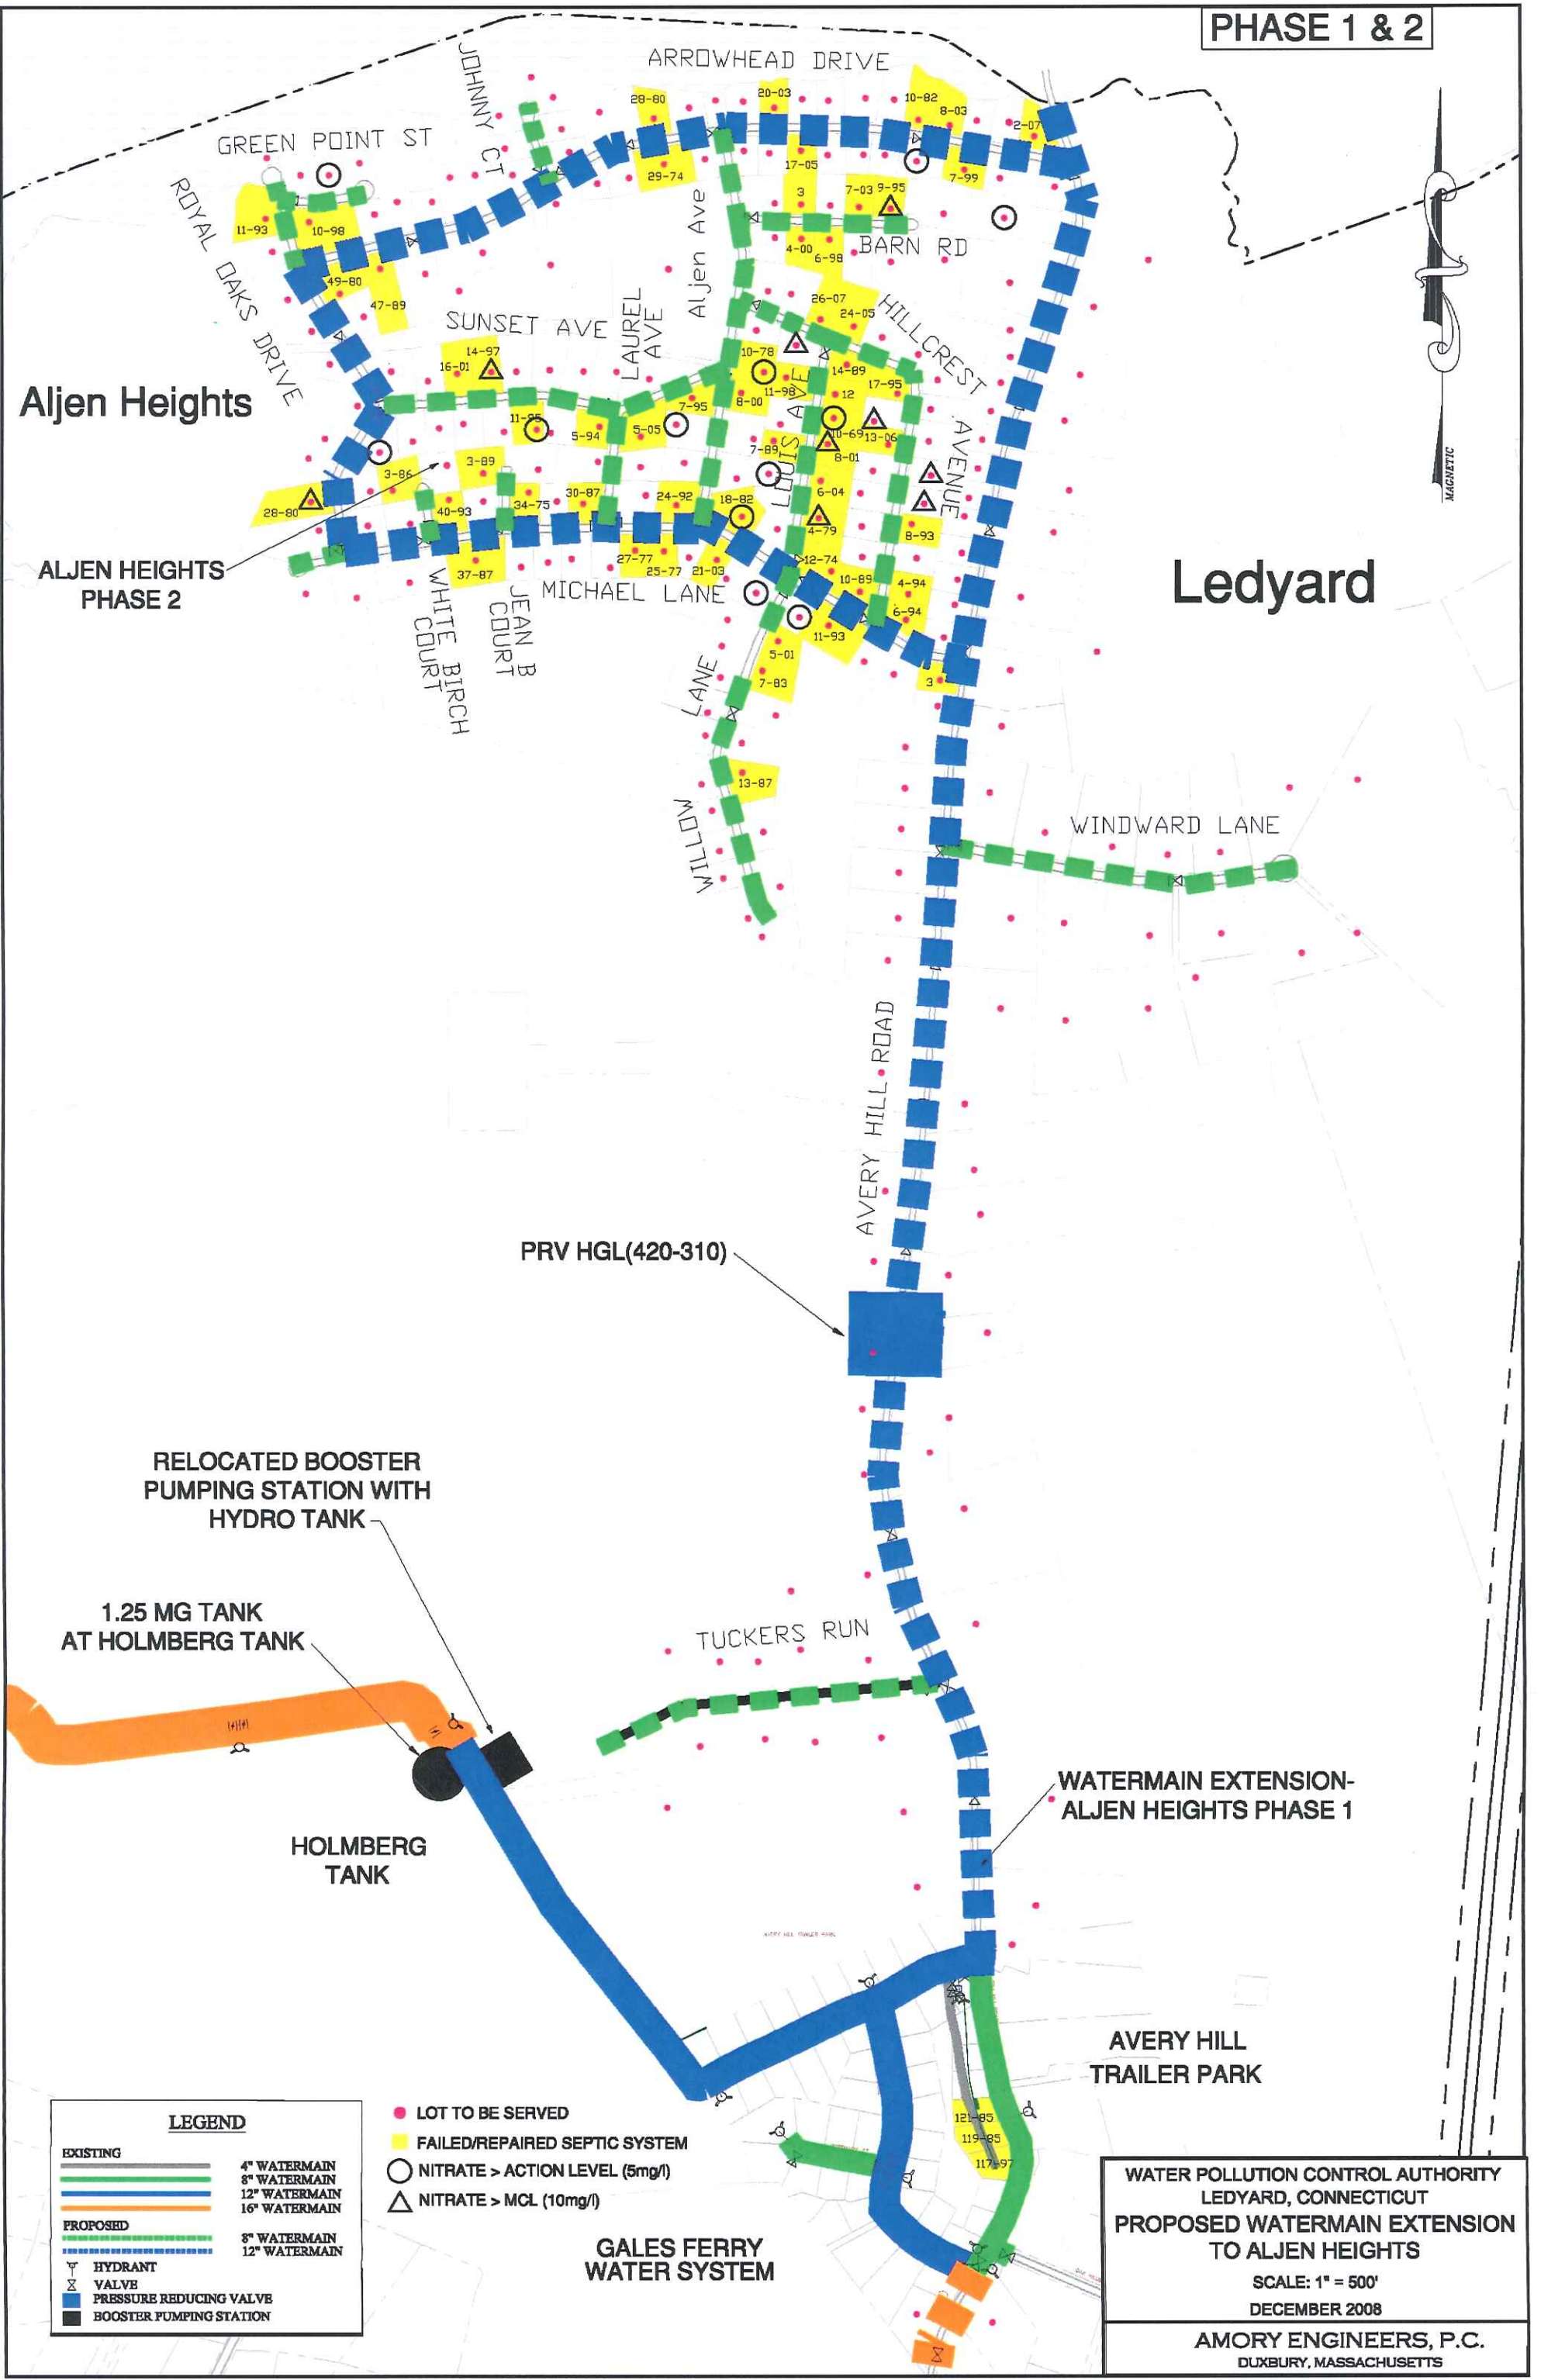

**Aljen Heights**

**Ledyard**

**ALJEN HEIGHTS PHASE 2**

PRV HGL(420-310)

RELOCATED BOOSTER PUMPING STATION WITH HYDRO TANK

1.25 MG TANK AT HOLMBERG TANK

HOLMBERG TANK

TUCKERS RUN

WATERMAIN EXTENSION-ALJEN HEIGHTS PHASE 1

AVERY HILL TRAILER PARK

GALES FERRY WATER SYSTEM

**LEGEND**

<b>EXISTING</b>	4" WATERMAIN
	8" WATERMAIN
	12" WATERMAIN
	16" WATERMAIN
<b>PROPOSED</b>	8" WATERMAIN
	12" WATERMAIN
▽	HYDRANT
X	VALVE
■	PRESSURE REDUCING VALVE
■	BOOSTER PUMPING STATION

- LOT TO BE SERVED
- FAILED/REPAIRED SEPTIC SYSTEM
- NITRATE > ACTION LEVEL (5mg/l)
- △ NITRATE > MCL (10mg/l)

WATER POLLUTION CONTROL AUTHORITY  
LEDYARD, CONNECTICUT  
**PROPOSED WATERMAIN EXTENSION TO ALJEN HEIGHTS**  
SCALE: 1" = 500'  
DECEMBER 2008  
AMORY ENGINEERS, P.C.  
DUXBURY, MASSACHUSETTS